

FAIL-SAFETM


Abort Gate

RBS-4



AIR Industries

13 SWANSON RD
NEW BOSTON, NH 03070 603-487-1117

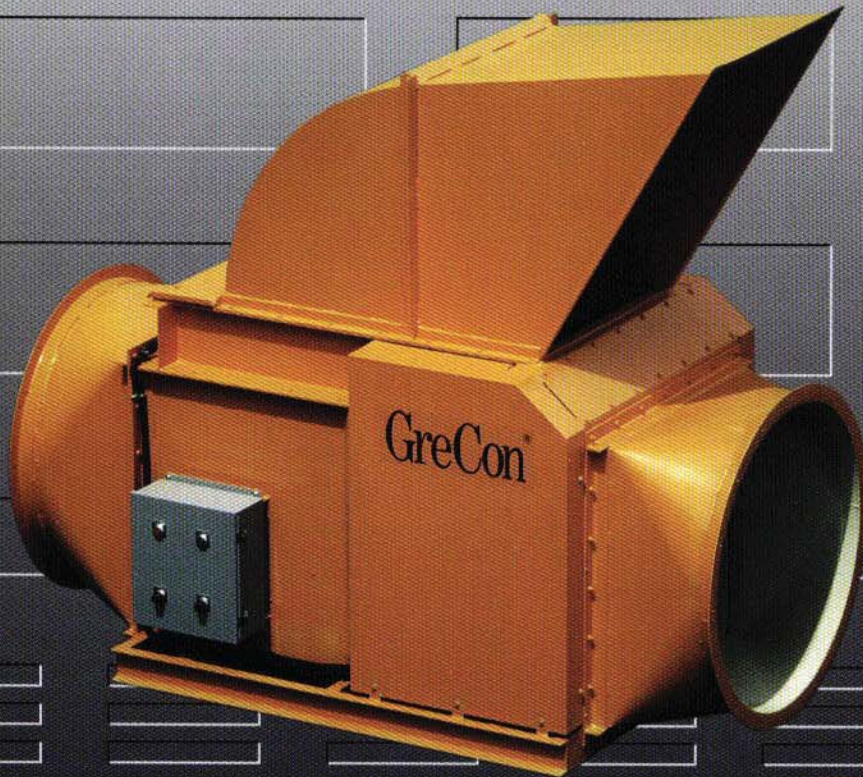

GreCon[®]

"Protect Plant Buildings and Dust Collection Equipment From Hazardous Air Flows"


Meets NFPA 664 Standard 8-4 for returning exhaust air to buildings.

**Fail-safe,
heat resistant
Electromagnet**

**Stainless steel
side seals**


**Chromed magnet
contact plate**

**Adjustable,
high temperature
gate seal-
corrosion and
abrasion resistant**

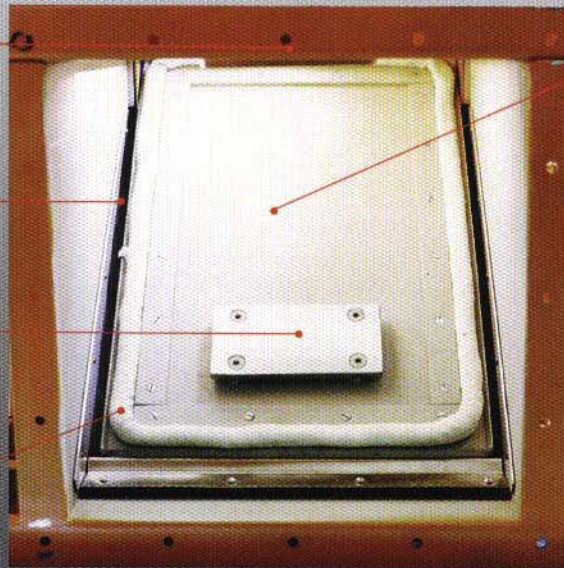

**Easily removable gate
for maintenance or
replacement**

**Automatic vacuum relief,
prevents pipe collapse**

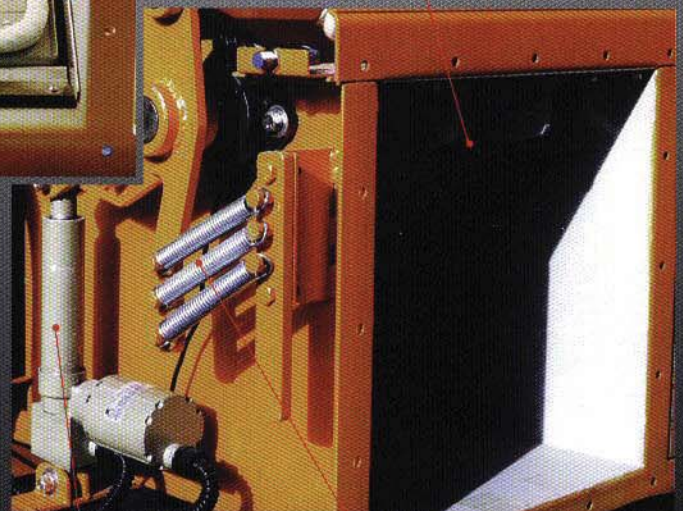

**Powered
electric
gate reset**

**Abort gate
accelerating
springs**

Specifications and Options

- Gate closure in less than 500 milliseconds.
- Standard weatherhood discharge is forward, in direction of airflow, with control panel on right side. Reverse or side discharge direction and left side panel location is available.
- Powered Reset System is standard. Manual reset available.
- Requires 120 VAC power supply.
- Co-flanges furnished as an option.
- Required support and access furnished by others.

GreCon[®]

the company you can depend on for ongoing technological advancements.

GreCon, Inc. 15875 S.W. 74th Ave.
Tigard, Oregon 97224
www.grecon-us.com
sales@grecon-us.com

For More Information Call Us At: (503) 641-7731 Fax: (503) 641-7508